





Colocar "Tabiques Separadores - DR-SF1\_" antes de la puesta en marcha según página 2.  
Install "Phase Barriers - DR-SF1\_" before starting the switch up according to page 2.  
Installer "Barrières de phase - DR-SF1\_" avant la mise en service selon à la page 2.

DR-EL1\_

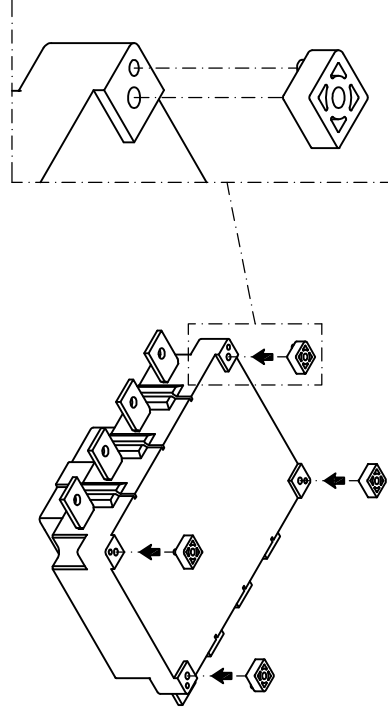

DR-SF1\_ + DR-CU1\_


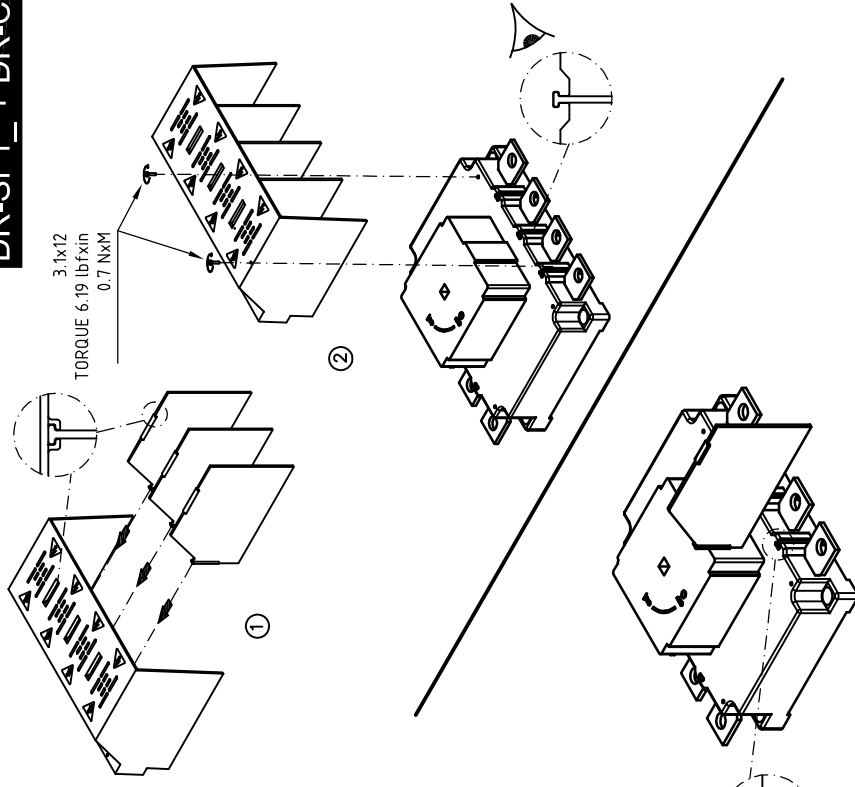


DR-SF1\_

Montar siempre los  
accesorios en posición OFF  
Always mount  
accessories on position OFF  
Installez toujours les  
accessoires en position OFF

O-OFF

DR-CU1\_

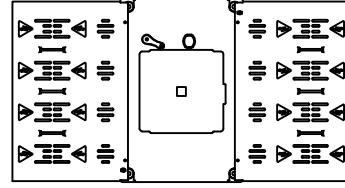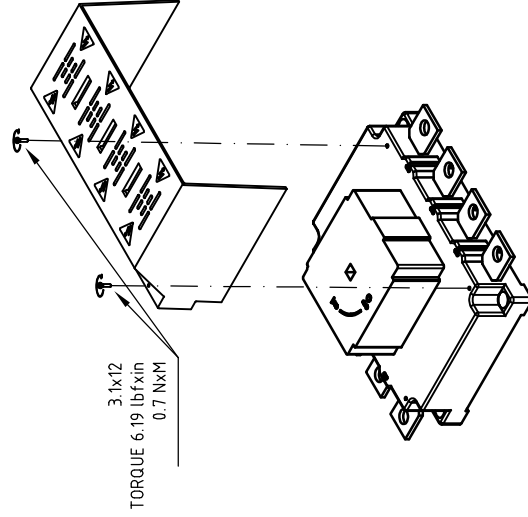

www.telergon.es





telergon  
g o r i e n

S6 / 1

4407Z002

2019-03-20




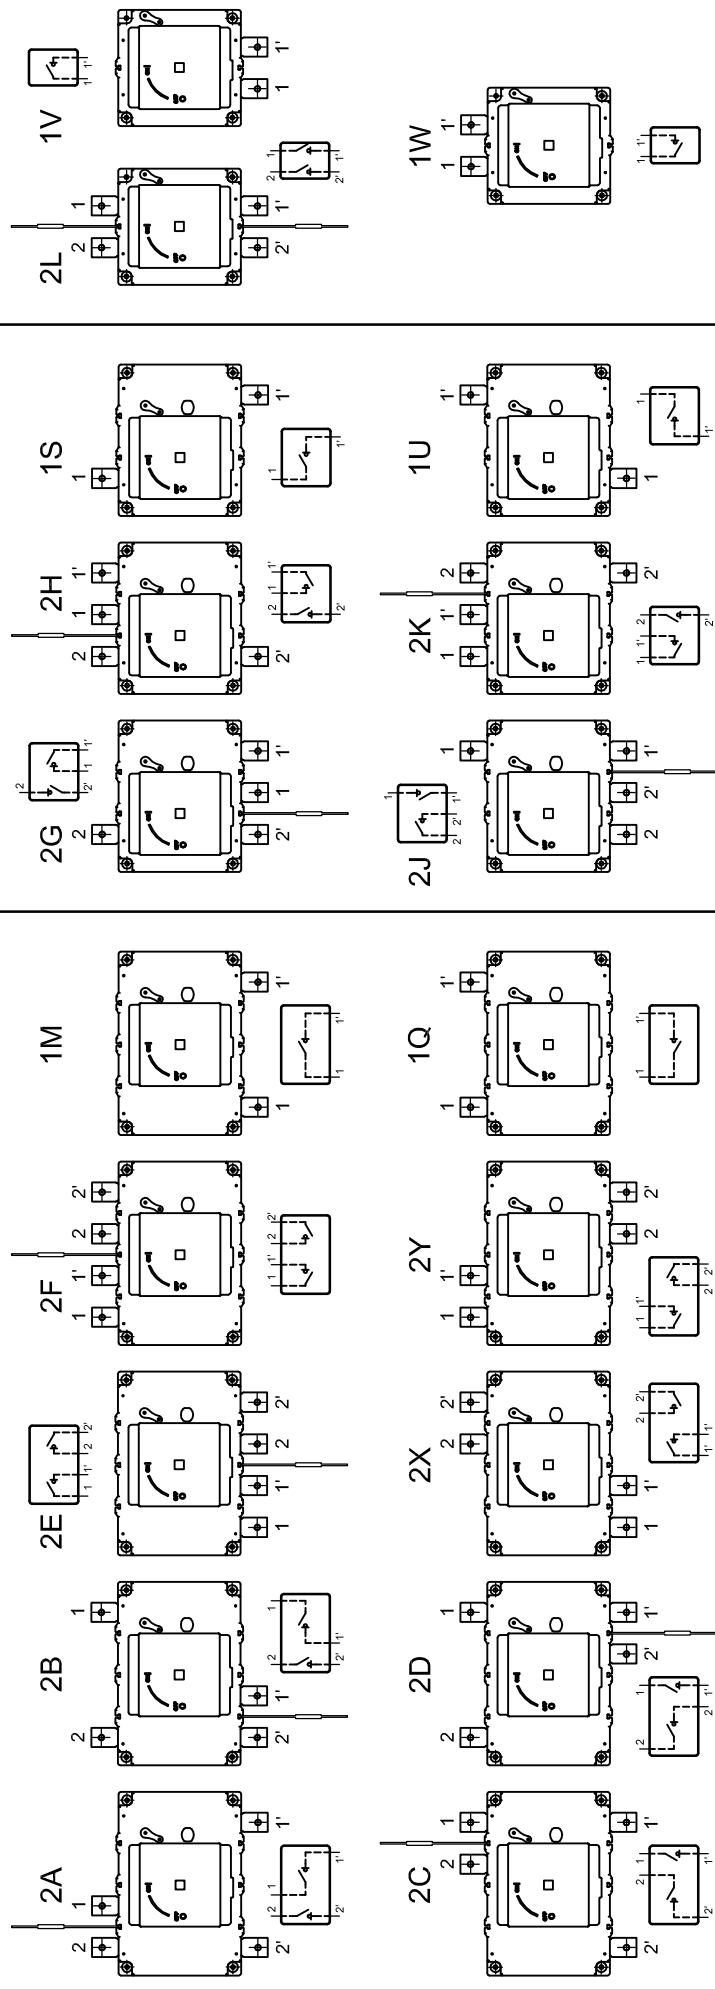

| DC GROUNDED - 1 POLE - 250A    |               |      |               |      |               |
|--------------------------------|---------------|------|---------------|------|---------------|
| Tipo                           | 1000Vdc       | Tipo | 750Vdc        | Tipo | 500Vdc        |
| 1M                             | S6-02501M__0L | 1S   | S6-02501S__0L | 1V   | S6-02501V__0L |
| 1Q                             | S6-02501Q__0L | 1U   | S6-02501U__0L | 1W   | S6-02501W__0L |
| DC UNGROUNDED - 2 POLES - 250A |               |      |               |      |               |
| Tipo                           | 1000Vdc       | Tipo | 750Vdc        | Tipo | 500Vdc        |
| 2A                             | S6-02502A__0L | 2G   | S6-02502G__0L | 2L   | S6-02502L__0L |
| 2B                             | S6-02502B__0L | 2H   | S6-02502H__0L |      |               |
| 2C                             | S6-02502C__0L | 2J   | S6-02502J__0L |      |               |
| 2E                             | S6-02502E__0L | 2K   | S6-02502K__0L |      |               |
| 2F                             | S6-02502F__0L |      |               |      |               |
| 2X                             | S6-02502X__0L |      |               |      |               |
| 2Y                             | S6-02502Y__0L |      |               |      |               |



- El uso de "Tabiques Separadores - DR-SF1\_" es obligatorio cuando se use el "Terminal Lug - DR-TL11", excepto los siguientes esquemas:  
2X, 2Y, 1M, 1Q, 1S, 1U, 1V, 1W
- Using "Phase Barriers - DR-SF1\_" is mandatory when "Terminal Lug - DR-TL11" is used, except the following schemes:  
2X, 2Y, 1M, 1Q, 1S, 1U, 1V, 1W
- L'utilisation de "Barrières de phase - DR-SF1\_" est obligatoire quand le "Terminal Lug - DR-TL11" est utilisé, sauf les suivantes schémas:  
2X, 2Y, 1M, 1Q, 1S, 1U, 1V, 1W



Telergon recomienda usar "Tabiques Separadores - DR-SF1\_" entre bornes contiguos.  
Telergon recommends using "Phase Barriers - DR-SF1\_" between adjoining terminals.  
Telergon recommande d'utiliser "Barrières de phase - DR-SF1\_" entre les bornes voisines.

En caso de duda, consulte el esquema eléctrico presente en la etiqueta de su interruptor.  
In cases of doubt, refer to the electric scheme located on the switch's label.  
En cas de doute, consultez le schéma électrique situé sur l'étiquette de l'interrupteur.